




- REV. 7-29-96: REDREW SHEET ON CADD AND MADE MINOR CHANGES.
- REV. 12-16-03: DELETED SPLICING DETAIL AND ADDED COMM/POWER BACKBONE TRENCH LAYOUT.
- REV. 7-29-04: ADDED TRENCH LAYOUT FOR COMM/ POWER BACKBONE DETAIL. DELETE DIRECT BURIAL DETAIL & TYPICAL SPLICING TAPING DETAILS.

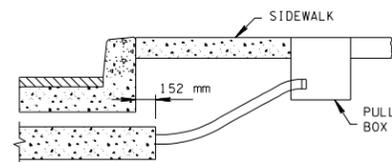


ELEVATION VIEW SHOWING CONDUIT PLACEMENT IN SIDEWALK SECTION

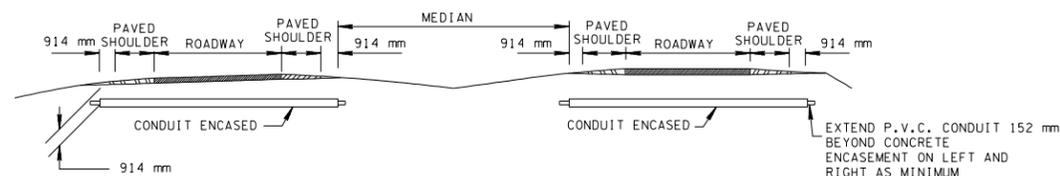

ELEVATION VIEW SHOWING CONDUIT PLACEMENT IN ROADWAY WITH PAVED SHOULDERS

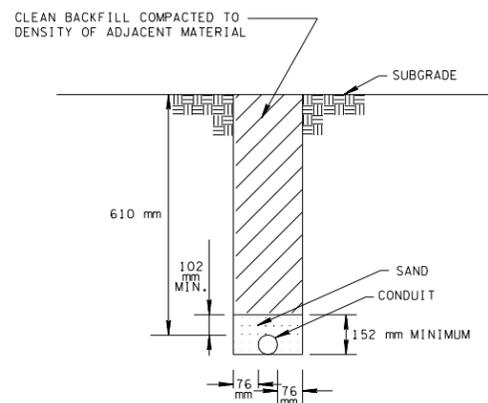


DIRECT BURIAL CONDUIT DETAILS IN EARTH

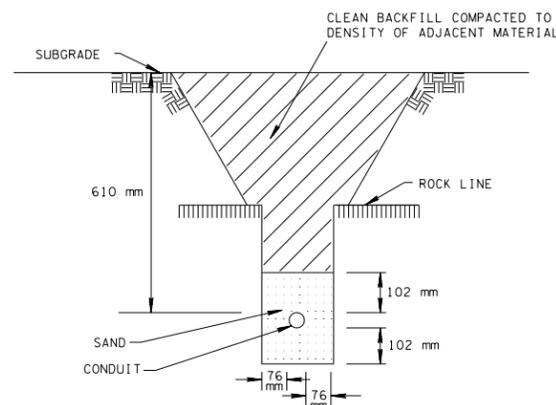


DIRECT BURIAL CONDUIT DETAILS IN ROCK


NOTE : WHERE THERE IS MORE THAN ONE CONDUIT PER TRENCH, CONDUITS SHALL NOT BE PLACED CLOSER THAN 203 mm CENTER TO CENTER.

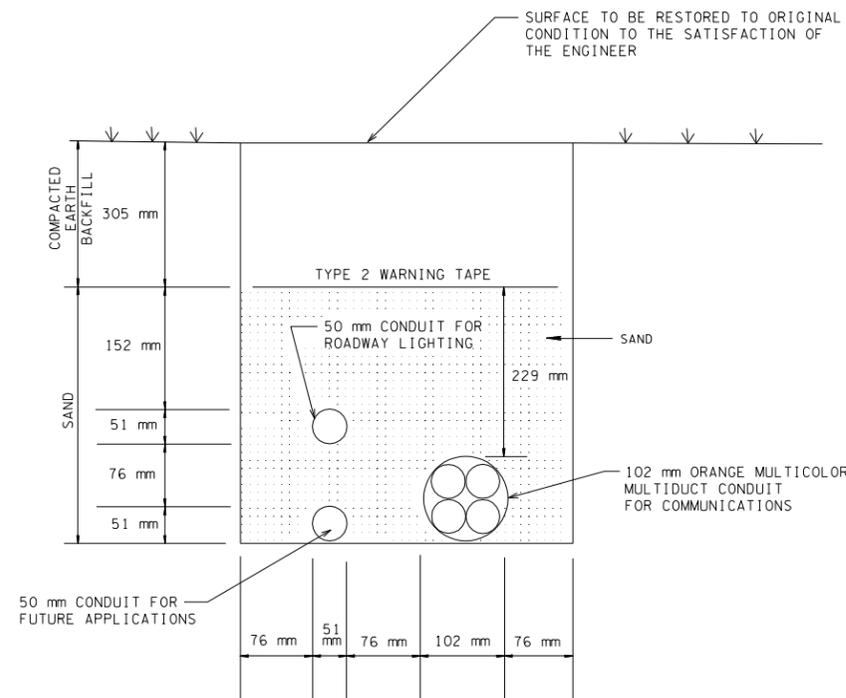

TYPICAL TRENCH LAYOUT FOR COMM/ POWER BACKBONE

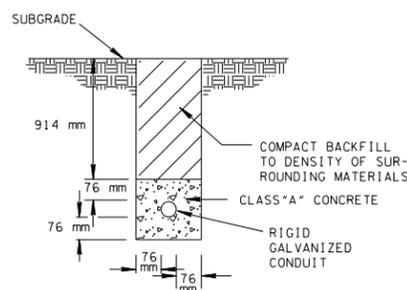

CONCRETE ENCASED CONDUIT IN EARTH

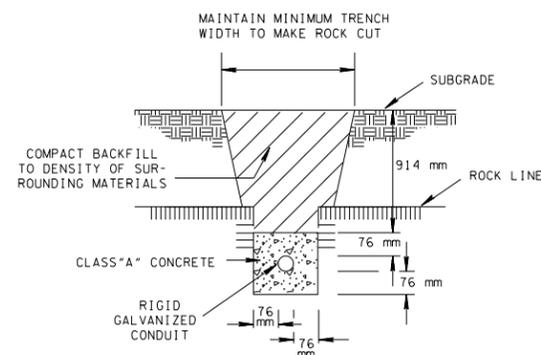

CONCRETE ENCASED CONDUIT IN ROCK



ALL UNITS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

MINOR REVISION -- FHWA APPROVAL NOT REQUIRED.

STATE OF TENNESSEE
DEPARTMENT OF TRANSPORTATION

STANDARD
LIGHTING DETAILS
CONDUIT, CABLE
INSTALLATION

11-1-95 TM-L-4

3/21/2007 10:06:35 AM
C:\CONS\PROJECTS\11-1-95\11-1-95.DWG