




**TYPICAL LAYOUT**

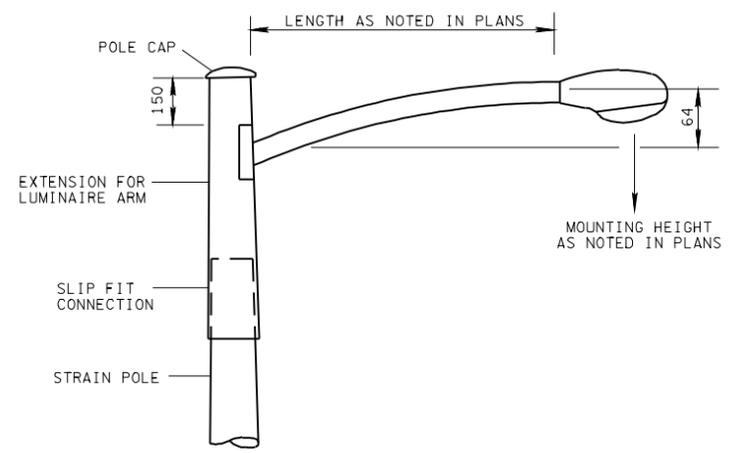

**DETAIL FOR LUMINAIRE EXTENSION AS REQ'D BY PLANS**

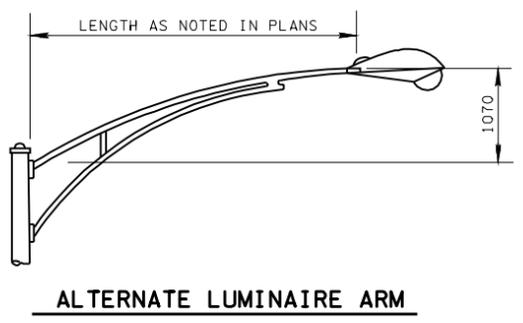


**ALTERNATE LUMINAIRE ARM**

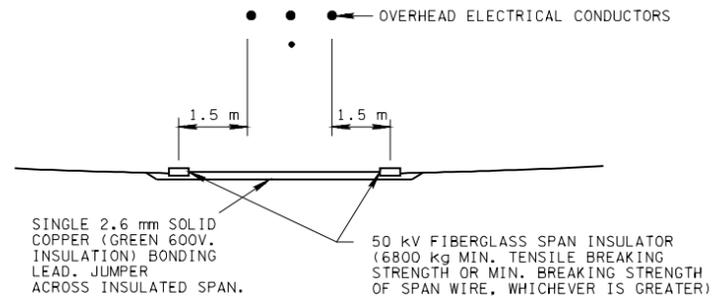


**DETAIL FOR INSTALLATION OF SPAN INSULATOR**

\*NOTE: THIS DETAIL DOES NOT APPLY IF VOLTAGE LEVEL ABOVE GROUND POTENTIAL FOR EACH ELECTRICAL CONDUCTOR IS 240 VOLTS OR LESS.

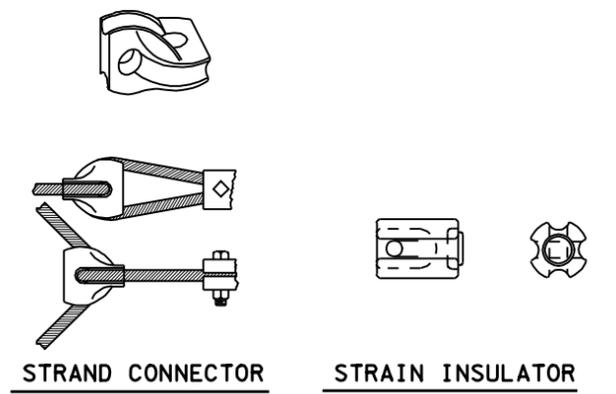


**STRAND CONNECTOR STRAIN INSULATOR**

STRAIN INSULATOR MAY BE SUBSTITUTED FOR THE STRAND CONNECTOR

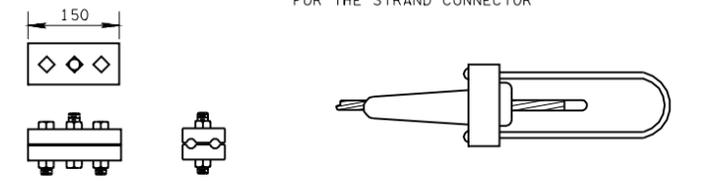


**THREE BOLT CLAMP DEAD END**

DEAD END CABLE GRIP MAY BE SUBSTITUTED FOR THREE BOLT CLAMP

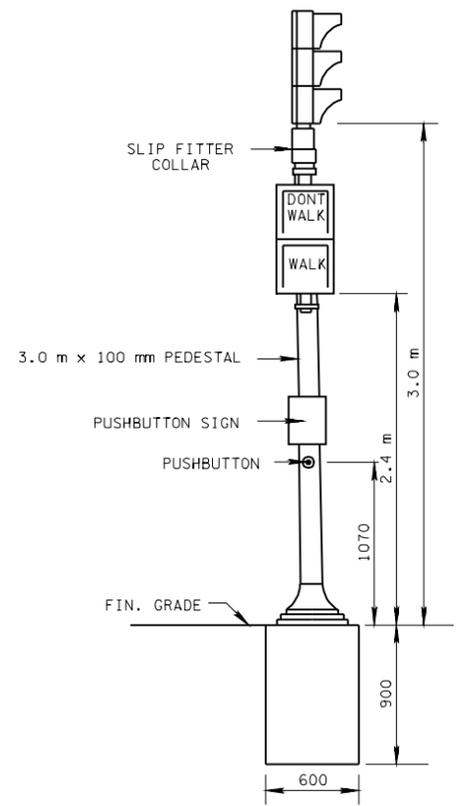


**TYPE A**

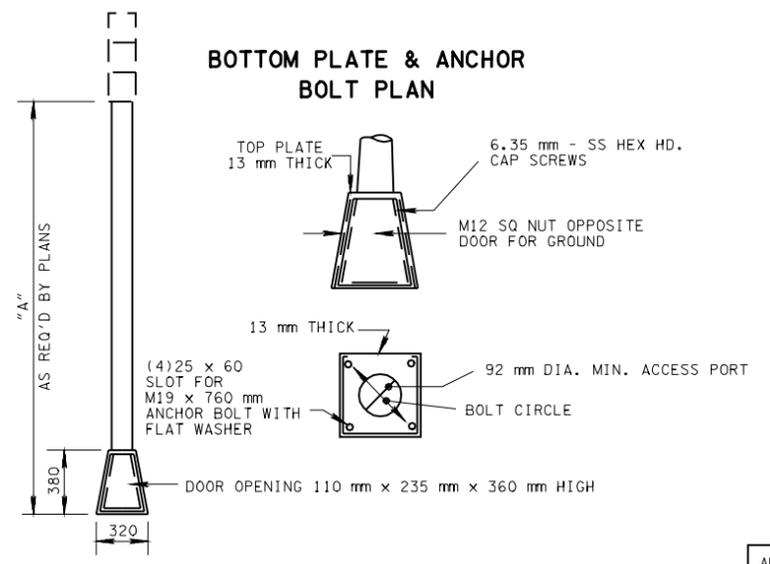

**TYPE B**

**PEDESTAL MOUNTING**



ALL UNITS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

MINOR REVISION -- FHWA APPROVAL NOT REQUIRED.

STATE OF TENNESSEE DEPARTMENT OF TRANSPORTATION

STRAIN POLE DETAILS FOR SPAN MOUNTED SIGNALS

SEE DRAWING NO. TM-SG-10 FOR OTHER DETAILS & NOTES