



PLAN
SCALE: 1"=100'

NOTE:
CAST IRON PIPE SHALL BE A5N CLASS 21, 2 3/4" IRON WITH COAL TAR COATING OUTSIDE AND CEMENT LINING INSIDE. CASING PIPE SHALL BE STANDARD WEIGHT BLACK STEEL PIPE WITH BITUMINOUS COATING.
BACKFILL MATERIAL SATISFACTORY TO THE STATE HIGHWAY DEPARTMENT SHALL BE USED IN BACKFILLING THE TRENCH (IT IS ANTICIPATED THAT BACKFILL MATERIAL WILL BE SUITABLE FOR BACKFILL). THE BACKFILL SHALL BE TAMPED IN SIX (6") INCH LAYERS ACROSS THE HIGHWAY, EXCEPT THAT THE TOP TWELVE (12") INCHES OF TRENCH ACROSS THE HIGHWAY SHALL BE BACKFILLED WITH 33-C STONE.

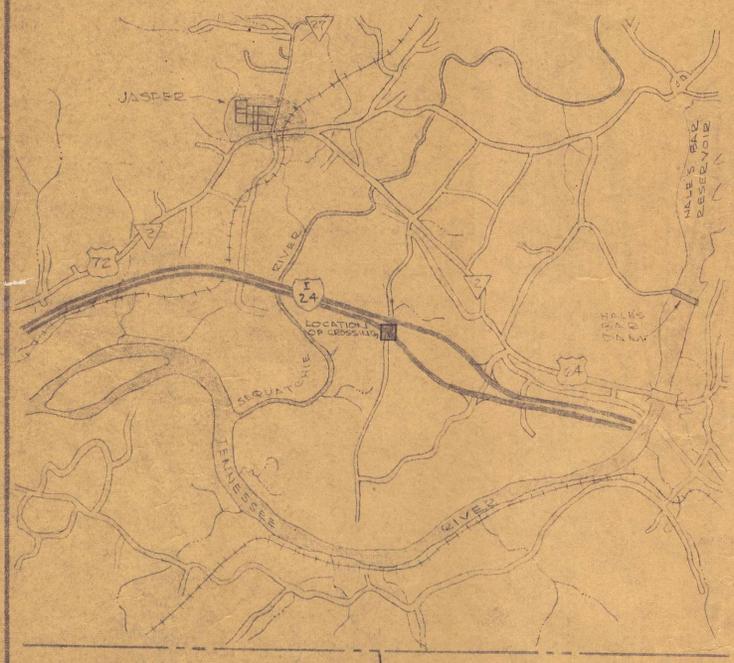

LOCATION MAP
SCALE: 1"=1 MILE

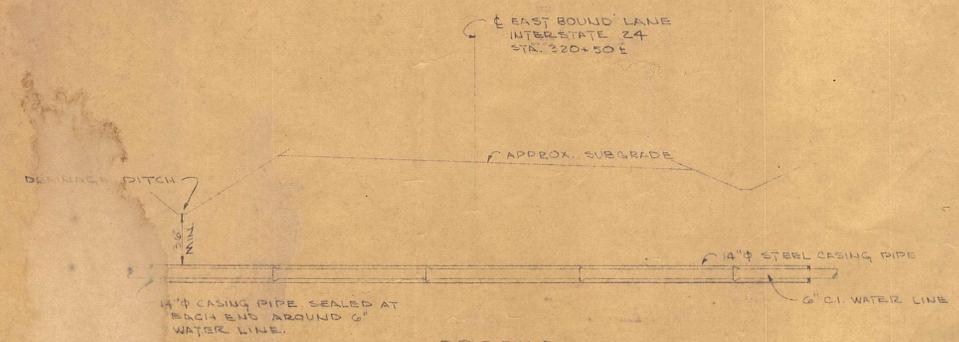

PROFILE
N.T.S.

Town of Jasper
JASPER, TENNESSEE

RELOCATION OF WATER LINE
ON INTERSTATE 24
AT SHELLMOUND ROAD

HENSHAW, HONEYCUTT & LEWIS INC.
CONSULTING ENGINEERS NASHVILLE, TENN.

DATE 11-14-66 DRAWN LW 1 OF 1