TENNESSEE D.O.T.
DESIGN DIVISION
FILE NO.

| TYPE | YEAR | PROJECT NO. | SHEET NO. |
|---|---|---|---|
| CONST. | 2015 | NH-29(86) | U2-11 |
| | | | |
| | | | |
| | | | |

MORGAN COUNTY 65001-3268-14

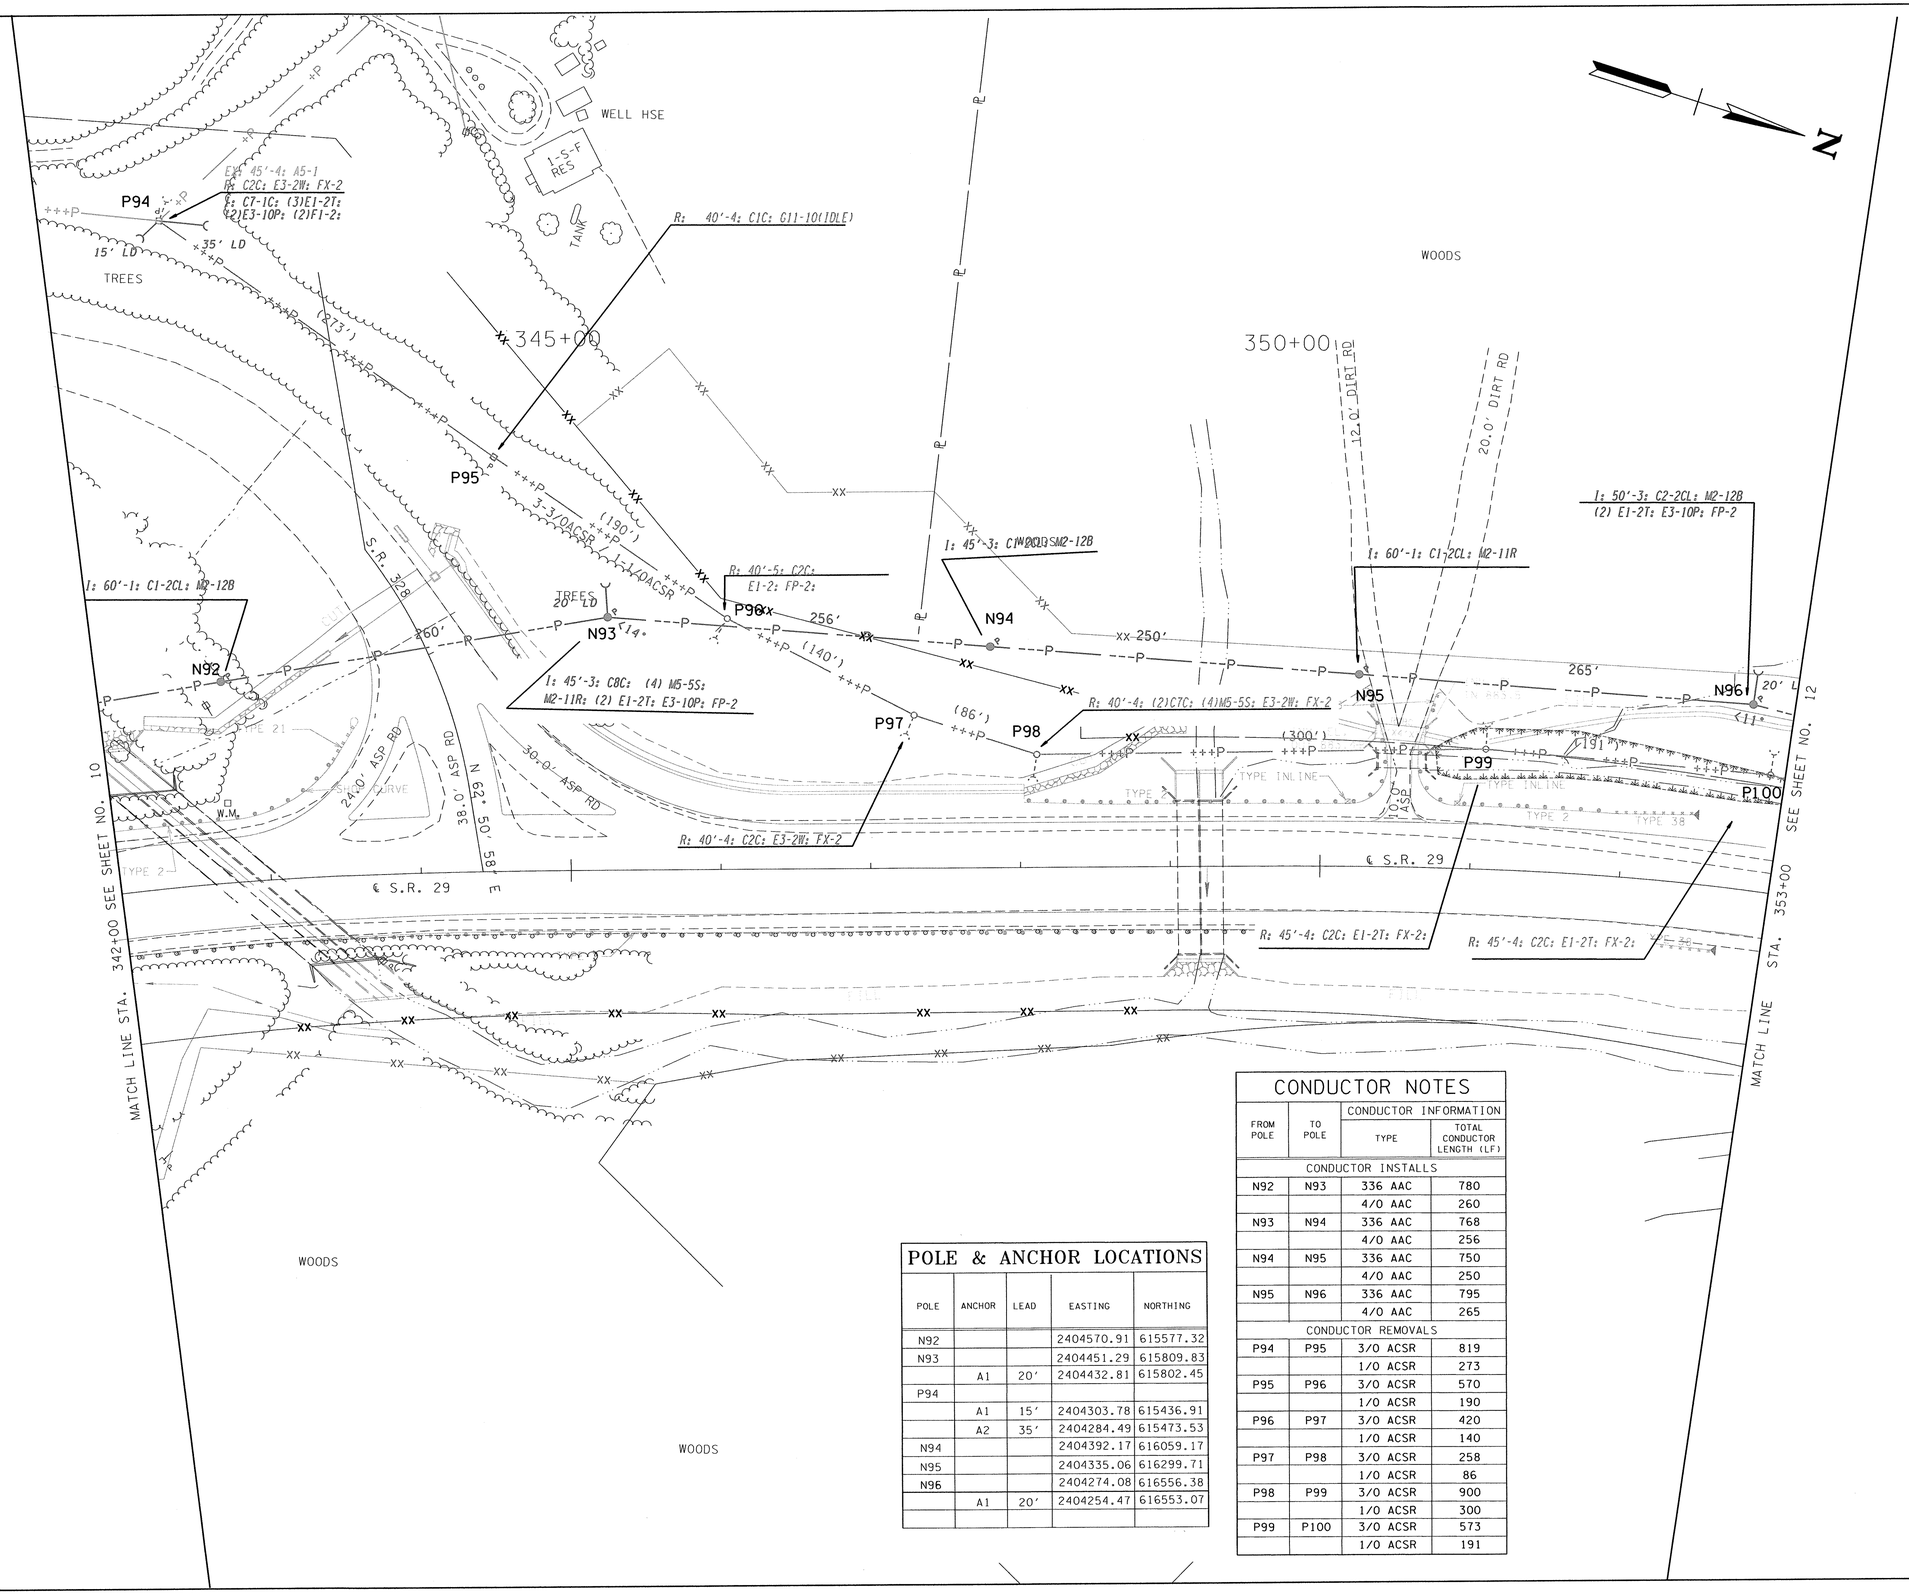


## POLE & ANCHOR LOCATIONS

| POLE | ANCHOR | LEAD | EASTING | NORTHING |
|---|---|---|---|---|
| N92 | | | 2404570.91 | 615577.32 |
| N93 | | | 2404451.29 | 615809.83 |
| | A1 | 20' | 2404432.81 | 615802.45 |
| P94 | | | | |
| | A1 | 15' | 2404303.78 | 615436.91 |
| | A2 | 35' | 2404284.49 | 615473.53 |
| N94 | | | 2404392.17 | 616059.17 |
| N95 | | | 2404335.06 | 616299.71 |
| N96 | | | 2404274.08 | 616556.38 |
| | A1 | 20' | 2404254.47 | 616553.07 |
| | | | | |

## CONDUCTOR NOTES

| FROM POLE | TO POLE | CONDUCTOR INFORMATION TYPE | TOTAL CONDUCTOR LENGTH (LF) |
|---|---|---|---|
| CONDUCTOR INSTALLS | | | |
| N92 | N93 | 336 AAC | 780 |
| | | 4/0 AAC | 260 |
| N93 | N94 | 336 AAC | 768 |
| | | 4/0 AAC | 256 |
| N94 | N95 | 336 AAC | 750 |
| | | 4/0 AAC | 250 |
| N95 | N96 | 336 AAC | 795 |
| | | 4/0 AAC | 265 |
| CONDUCTOR REMOVALS | | | |
| P94 | P95 | 3/0 ACSR | 819 |
| | | 1/0 ACSR | 273 |
| P95 | P96 | 3/0 ACSR | 570 |
| | | 1/0 ACSR | 190 |
| P96 | P97 | 3/0 ACSR | 420 |
| | | 1/0 ACSR | 140 |
| P97 | P98 | 3/0 ACSR | 258 |
| | | 1/0 ACSR | 86 |
| P98 | P99 | 3/0 ACSR | 900 |
| | | 1/0 ACSR | 300 |
| P99 | P100 | 3/0 ACSR | 573 |
| | | 1/0 ACSR | 191 |


Cannon&Cannon, Inc.
Consulting Engineers • Field Surveyors
8550 Kingston Pike
Knoxville, Tennessee 37919
Telephone: (865) 670-8555 • Fax: (865) 670-8866
www.cannon-cannon.com


HARRIMAN UTILITY BOARD
300 North Roane Street
Harriman, TN 37748
Phone (865) 882-3242

# ELECTRIC RELOCATION

STA. 342+00 TO STA. 353+00

JEFF L. MEADOR REGISTERED ENGINEER AGRICULTURE COMMERCE 23005 STATE OF TENNESSEE

| | |
|---|---|
| CCI NO. | 923-0005 |
| P.I.C. | JEFF MEADOW |
| DRAWN | JNR |
| D.C. | DM |
| SCALE: 1" = 50' | DATE: 8-29-2014 |

9/5/2014 12:18:00 PM
Z:\00923-0005\UTILITIES\B Date\DGN FILES\ROSR29U2-11.sht

Survey & Design Division