TENNESSEE D.O.T.
DESIGN DIVISION
FILE NO. ____

| TYPE | YEAR | PROJECT NO. | SHEET NO. |
|---|---|---|---|
| CONST. | 2015 | NH-29(86) | U5-2 |
| | | | |
| | | | |
| | | | |

MORGAN COUNTY 65001-3268-14

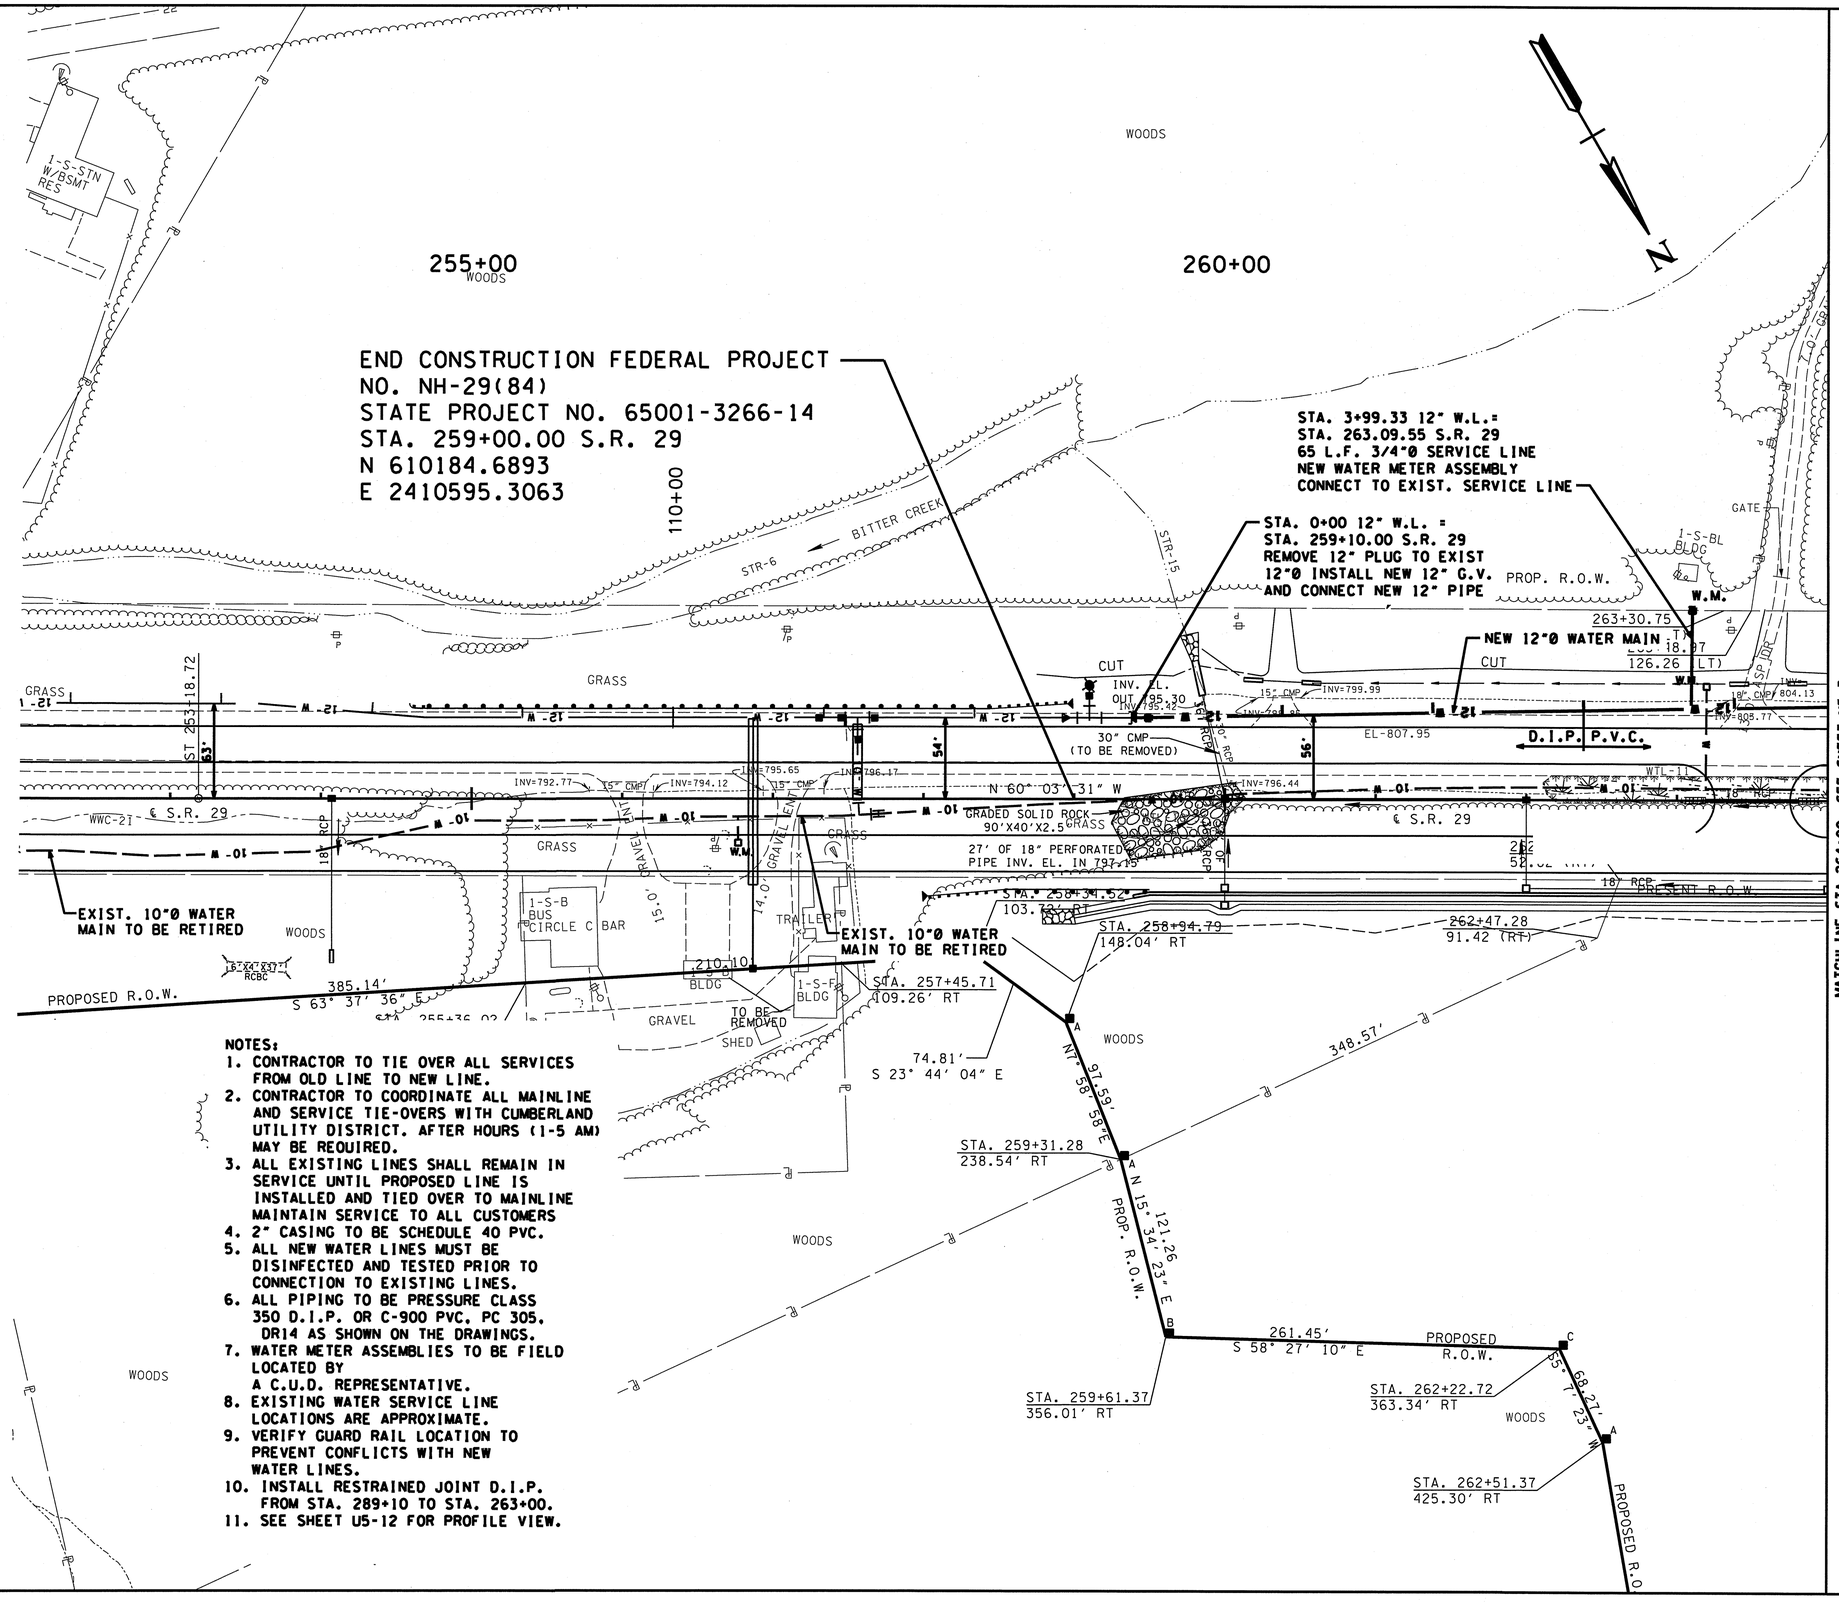


NOTES:
1. CONTRACTOR TO TIE OVER ALL SERVICES FROM OLD LINE TO NEW LINE.
2. CONTRACTOR TO COORDINATE ALL MAINLINE AND SERVICE TIE-OVERS WITH CUMBERLAND UTILITY DISTRICT. AFTER HOURS (1-5 AM) MAY BE REQUIRED.
3. ALL EXISTING LINES SHALL REMAIN IN SERVICE UNTIL PROPOSED LINE IS INSTALLED AND TIED OVER TO MAINLINE MAINTAIN SERVICE TO ALL CUSTOMERS
4. 2" CASING TO BE SCHEDULE 40 PVC.
5. ALL NEW WATER LINES MUST BE DISINFECTED AND TESTED PRIOR TO CONNECTION TO EXISTING LINES.
6. ALL PIPING TO BE PRESSURE CLASS 350 D.I.P. OR C-900 PVC, PC 305, DR14 AS SHOWN ON THE DRAWINGS.
7. WATER METER ASSEMBLIES TO BE FIELD LOCATED BY A C.U.D. REPRESENTATIVE.
8. EXISTING WATER SERVICE LINE LOCATIONS ARE APPROXIMATE.
9. VERIFY GUARD RAIL LOCATION TO PREVENT CONFLICTS WITH NEW WATER LINES.
10. INSTALL RESTRAINED JOINT D.I.P. FROM STA. 289+10 TO STA. 263+00.
11. SEE SHEET U5-12 FOR PROFILE VIEW.

CUD9IL.U2-17/4-19-11
P:\CUD9I\DESIGN\CUD9IL.U5-2.dgn

Survey & Design Division

STATE OF TENNESSEE
DEPARTMENT OF TRANSPORTATION
BUREAU OF PLANNING & DEVELOPMENT

# WATER RELOCATION

STA.252+00 TO STA. 264+00

SCALE: 1"= 50' HORIZ.