TENNESSEE D.O.T.
DESIGN DIVISION
FILE NO. ____

| TYPE | YEAR | PROJECT NO. | SHEET NO. |
|---|---|---|---|
| CONST. | 2015 | NH-29(86) | U5-10 |
| | | | |
| | | | |
| | | | |

MORGAN COUNTY 65001-3268-14

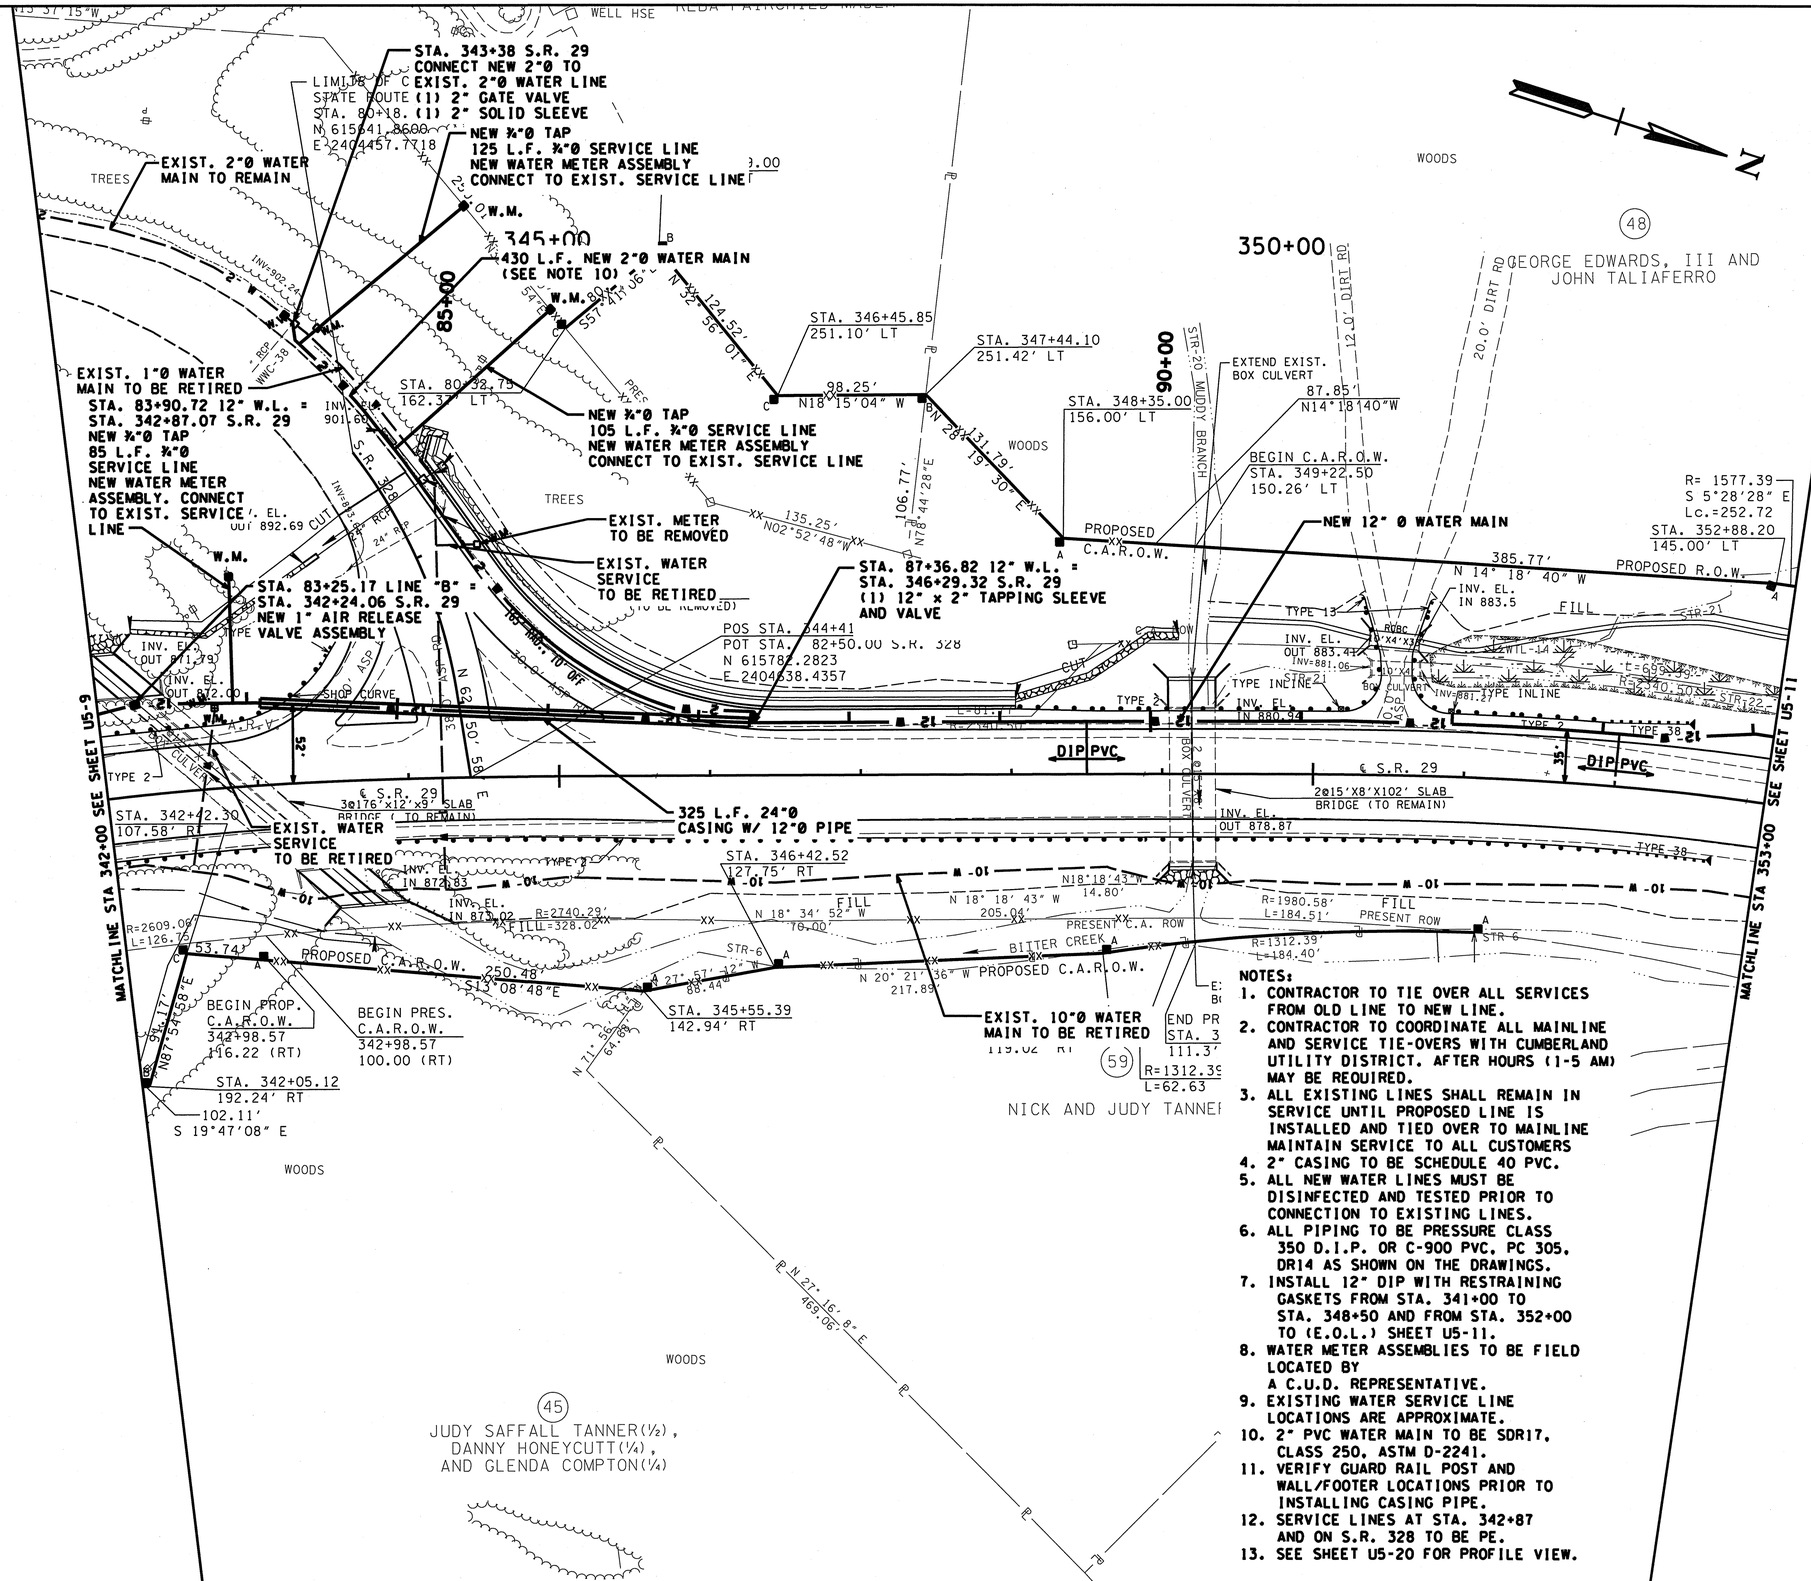


NOTES:

1. CONTRACTOR TO TIE OVER ALL SERVICES FROM OLD LINE TO NEW LINE.
2. CONTRACTOR TO COORDINATE ALL MAINLINE AND SERVICE TIE-OVERS WITH CUMBERLAND UTILITY DISTRICT. AFTER HOURS (1-5 AM) MAY BE REQUIRED.
3. ALL EXISTING LINES SHALL REMAIN IN SERVICE UNTIL PROPOSED LINE IS INSTALLED AND TIED OVER TO MAINLINE MAINTAIN SERVICE TO ALL CUSTOMERS
4. 2" CASING TO BE SCHEDULE 40 PVC.
5. ALL NEW WATER LINES MUST BE DISINFECTED AND TESTED PRIOR TO CONNECTION TO EXISTING LINES.
6. ALL PIPING TO BE PRESSURE CLASS 350 D.I.P. OR C-900 PVC, PC 305, DR14 AS SHOWN ON THE DRAWINGS.
7. INSTALL 12" DIP WITH RESTRAINING GASKETS FROM STA. 341+00 TO STA. 348+50 AND FROM STA. 352+00 TO (E.O.L.) SHEET U5-11.
8. WATER METER ASSEMBLIES TO BE FIELD LOCATED BY A C.U.D. REPRESENTATIVE.
9. EXISTING WATER SERVICE LINE LOCATIONS ARE APPROXIMATE.
10. 2" PVC WATER MAIN TO BE SDR17, CLASS 250, ASTM D-2241.
11. VERIFY GUARD RAIL POST AND WALL/FOOTER LOCATIONS PRIOR TO INSTALLING CASING PIPE.
12. SERVICE LINES AT STA. 342+87 AND ON S.R. 328 TO BE PE.
13. SEE SHEET U5-20 FOR PROFILE VIEW.

GARY STEVEN BOYD
REGISTERED ENGINEER
No. 19139
TENNESSEE

STATE OF TENNESSEE
DEPARTMENT OF TRANSPORTATION
BUREAU OF PLANNING & DEVELOPMENT

# WATER RELOCATION

STA. 342+00 TO STA. 353+00

SCALE: 1"= 50' HORIZ.

CUD9II U2-25/4-19-11
$$$$DCNSPEC$$$$

Survey & Design Division