TENNESSEE D.O.T.
DESIGN DIVISION
FILE NO. ____

| TYPE | YEAR | PROJECT NO. | SHEET NO. |
|---|---|---|---|
| CONST. | 2015 | NH-29(86) | U5-8 |
| | | | |
| | | | |
| | | | |

MORGAN COUNTY 65001-3268-14

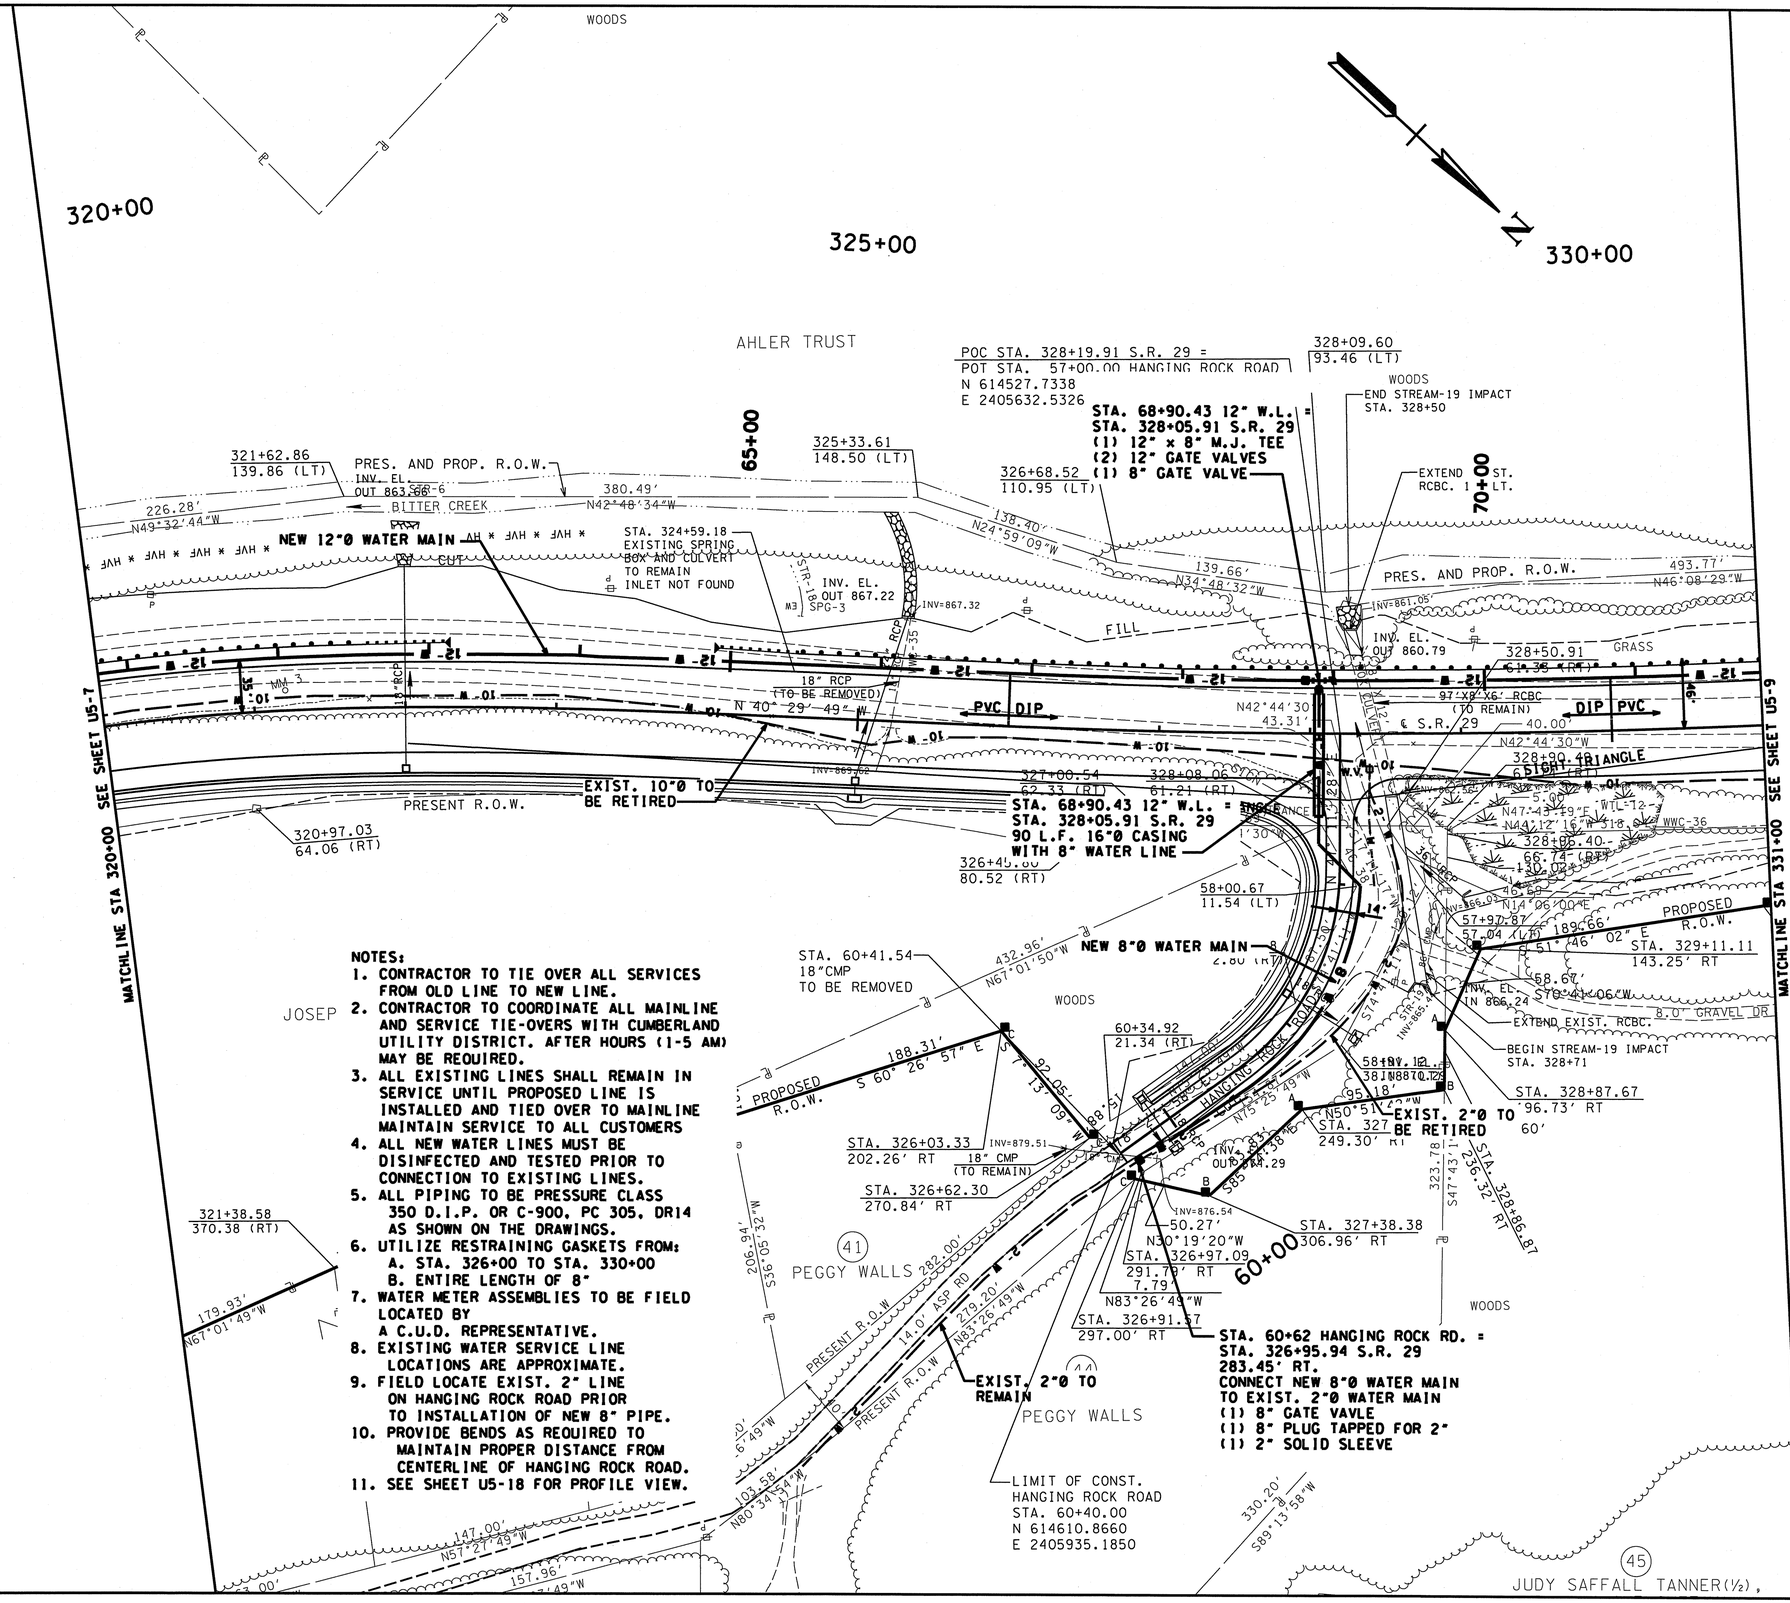


NOTES:

1. CONTRACTOR TO TIE OVER ALL SERVICES FROM OLD LINE TO NEW LINE.
2. CONTRACTOR TO COORDINATE ALL MAINLINE AND SERVICE TIE-OVERS WITH CUMBERLAND UTILITY DISTRICT. AFTER HOURS (1-5 AM) MAY BE REQUIRED.
3. ALL EXISTING LINES SHALL REMAIN IN SERVICE UNTIL PROPOSED LINE IS INSTALLED AND TIED OVER TO MAINLINE MAINTAIN SERVICE TO ALL CUSTOMERS
4. ALL NEW WATER LINES MUST BE DISINFECTED AND TESTED PRIOR TO CONNECTION TO EXISTING LINES.
5. ALL PIPING TO BE PRESSURE CLASS 350 D.I.P. OR C-900, PC 305, DR14 AS SHOWN ON THE DRAWINGS.
6. UTILIZE RESTRAINING GASKETS FROM:
   A. STA. 326+00 TO STA. 330+00
   B. ENTIRE LENGTH OF 8"
7. WATER METER ASSEMBLIES TO BE FIELD LOCATED BY A C.U.D. REPRESENTATIVE.
8. EXISTING WATER SERVICE LINE LOCATIONS ARE APPROXIMATE.
9. FIELD LOCATE EXIST. 2" LINE ON HANGING ROCK ROAD PRIOR TO INSTALLATION OF NEW 8" PIPE.
10. PROVIDE BENDS AS REQUIRED TO MAINTAIN PROPER DISTANCE FROM CENTERLINE OF HANGING ROCK ROAD.
11. SEE SHEET U5-18 FOR PROFILE VIEW.

CUD9ILU2-23/4-19-11
$$$$DGNSPEC$$$$