
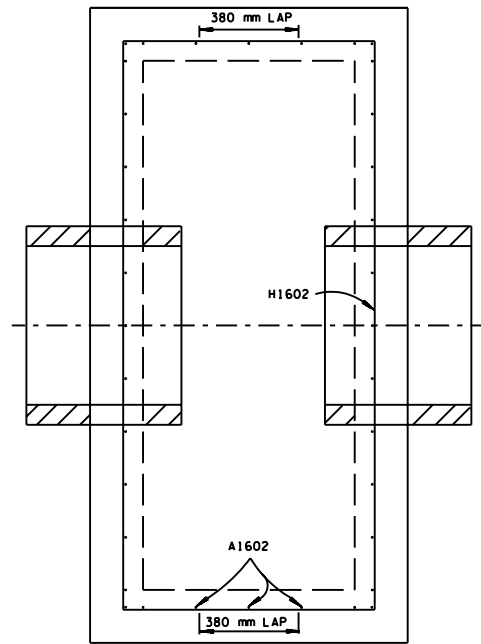


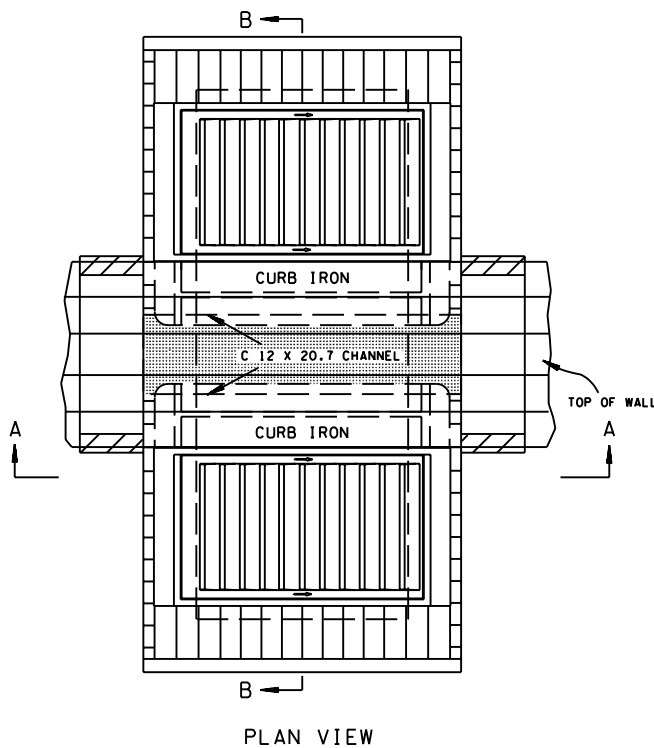

SECTION E-E

REINFORCING STEEL LEGEND					
1065	A1600			710	H1601
2285	A1601	710	710	2185	H1600
VARIABLE	A1602		990	735	H1602
				2210	

GENERAL NOTES

- DRAWING TO BE USED FOR ALL CAST-IN-PLACE NO. 32 CONCRETE CATCH BASINS AND ALL PRECAST NO. 32 CONCRETE CATCH BASINS.
- CAST-IN-PLACE CONCRETE CATCH BASINS SHALL BE CONSTRUCTED IN ACCORDANCE WITH STANDARD SPECIFICATIONS, SECTION 611 AND/OR SPECIAL PROVISIONS.
- THE CONTRACTOR MAY WITH PERMISSION FROM THE ENGINEER SUBSTITUTE PRECAST CATCH BASINS FOR CAST-IN-PLACE CATCH BASINS PROVIDED THAT ALL PRECAST ELEMENTS MEET ASTM M913 (CURRENT EDITION) UNLESS SUPERSEDED BY THIS DRAWING.
CONCRETE: $f'_c = 28 \text{ MPa}$ AT 28 DAYS
REINFORCING STEEL: ASTM A615M, $f_y = 415 \text{ MPa}$
ALL REINFORCING IS TO BE INSTALLED AS DETAILED ON THIS DRAWING.
- THE C 12 X 20.7 CHANNEL SHALL MEET ASTM A36 SPECIFICATION. IT IS TO BE CUT 1219 mm IN LENGTH AND INSTALLED WITH THE FLANGE DOWN ON TOP OF WALL.
- PRECAST CATCH BASIN UNITS WHICH ARE DAMAGED DURING SHIPMENT OR INSTALLATION WILL BE REJECTED. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO REPLACE DAMAGED CATCH BASIN UNITS AT HIS OWN EXPENSE.
- ADDITIONAL REINFORCING STEEL NECESSARY ABOVE THE CORED OR FORMED CUT-OUT HOLES TO MAINTAIN THE INTEGRITY OF THE STRUCTURE DURING HANDLING AND PLACEMENT SHALL BE THE RESPONSIBILITY OF THE FABRICATOR.
- APPROPRIATE SIZING AND LOCATION OF LIFTING DEVICES SHALL BE THE RESPONSIBILITY OF THE FABRICATOR TO ASSURE BALANCED HANDLING DURING INSTALLATION OF THE CATCH BASIN.
- THE CONTRACTOR IS TO PATCH ALL LIFTING DEVICE HOLES AND PLACE A MINIMUM OF 25 mm OF COVER OVER THE HARDWARE OF THESE DEVICES ON BOTH TOP AND BOTTOM SURFACES.
- INVERT ELEVATIONS ARE TO BE ADJUSTED AS DIRECTED BY THE ENGINEER IN ORDER TO ACCOMMODATE INLET AND OUTLET PIPES.
- SEE STANDARD DRAWING DM-CBB-31 FOR DETAILS REGARDING CAST IRON GRATES, FRAMES AND CURB INLETS.
- PAYMENT FOR CATCH BASIN WILL BE MADE UNDER ITEM NUMBERS 611M32.01 CATCH BASINS, TYPE 32, 0m-1m DEPTH AND 611M32.02 CATCH BASINS, TYPE 32, > 1m-2m DEPTH PER EACH.

CATCH BASIN MAXIMUM DEPTH NOTE

MAXIMUM DEPTH FOR THIS STRUCTURE IS 1.7 m. WHEN DEPTH REQUIREMENTS EXCEED THIS DEPTH THE CONTRACTOR IS TO USE VERSIONS OF THE NO. 31 CATCH BASIN.

CUT-OUT HOLES FOR INLET & OUTLET PIPES


INSIDE DIAMETER (X) OF PIPE (mm)	DIAMETER OF CUT-OUT HOLES F & G - (mm)		
	CONCRETE PIPE	CORRUGATED METAL PIPE	POLYETHYLENE PIPE
375	560	455	510
450	660	535	610
600	815	685	785

CUT-OUT HOLES FOR PRECAST STRUCTURES TO BE CORED OR FORMED IN ORDER TO OBTAIN A SMOOTH EDGED HOLE. SCORED OR ETCHED HOLES WITH REINFORCING STEEL LEFT UNCUT WILL NOT BE PERMITTED.


CATCH BASIN MINIMUM DEPTH TABLE

INSIDE DIAMETER (X) OF PIPE (mm)	MINIMUM DEPTH - (m)		
	CONCRETE PIPE	CORRUGATED METAL PIPE	POLYETHYLENE PIPE
375	0.95	0.90	0.92
450	1.04	0.97	1.01
600	1.19	1.12	1.18


- DEPTH MEASUREMENT MADE FROM TOP OF GRATE TO OUTLET FLOW ELEVATION BASED ON INLET AND OUTLET PIPES BEING THE SAME DIAMETER. IF OUTLET PIPE IS GREATER ADJUSTMENT IN DEPTHS MUST BE MADE TO ACCOMMODATE THIS SITUATION.
- MINIMUM DEPTH TO BE REDUCED BY 35 mm WHERE ONLY OUTLET PIPE EXIST.
- TO DETERMINE FLOOR OF CATCH BASIN ELEVATION, WHEN INLET AND OUTLET PIPES ARE THE SAME SIZE, ADD PIPE WALL THICKNESS PLUS 40 mm TO THE ABOVE MINIMUM DEPTHS.

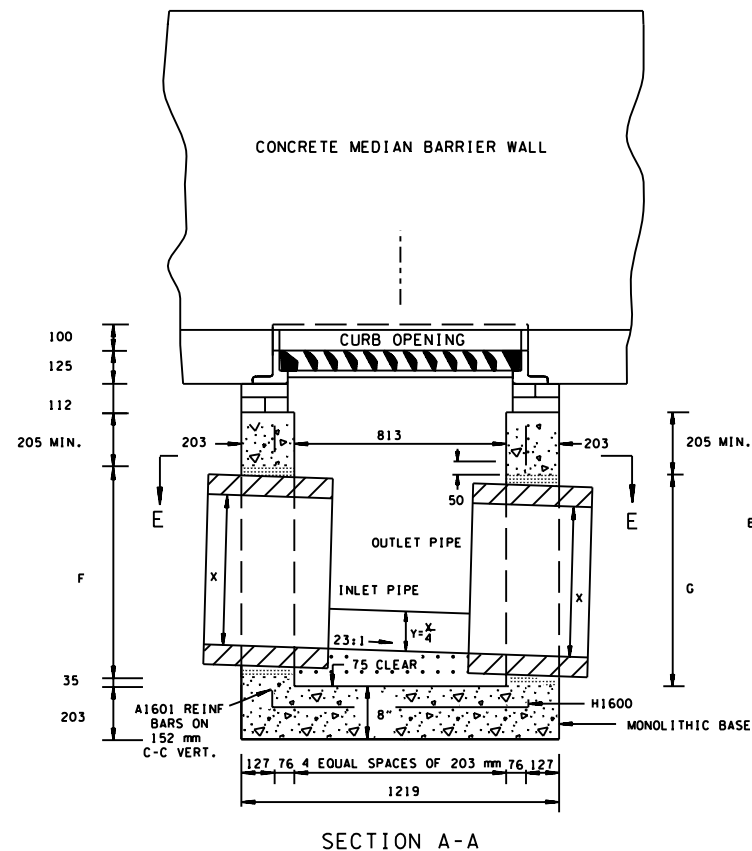

SECTION A-A

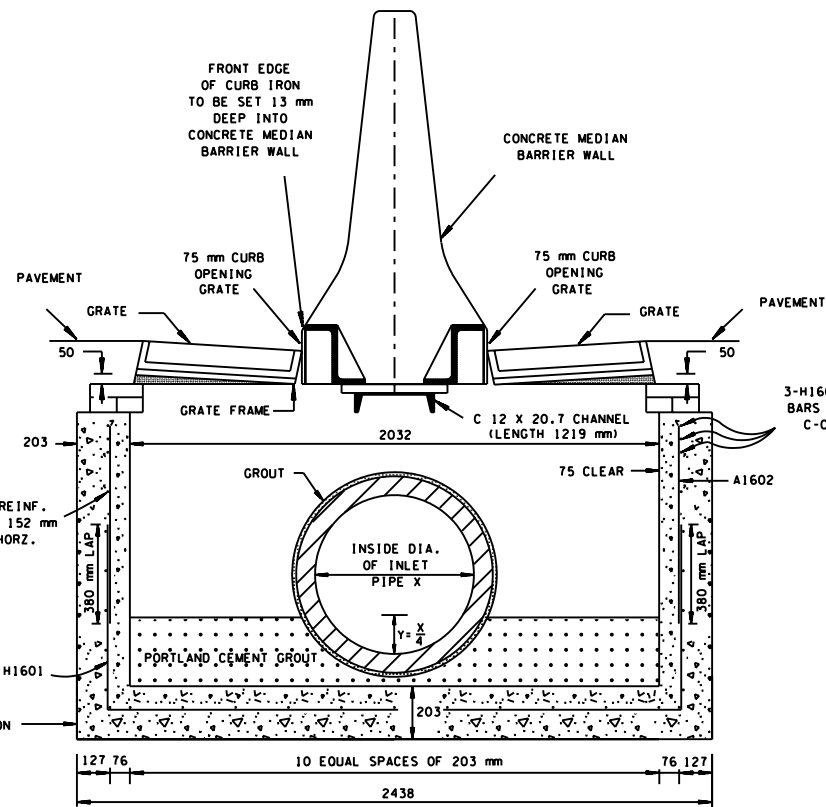

SECTION B-B



ALL UNITS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

MINOR REVISION -- FHWA APPROVAL NOT REQUIRED.

STATE OF TENNESSEE
DEPARTMENT OF TRANSPORTATION

STANDARD
2032 mm X 813 mm
RECTANGULAR CONCRETE
NO. 32 CATCH BASIN
(FOR USE UNDER CONCRETE
MEDIAN BARRIER WALL)

6-30-03 DM-CB-32LP